



PARTITION TYPE 'A1' SCALE: $1 \frac{1}{2} = 1'-0"$

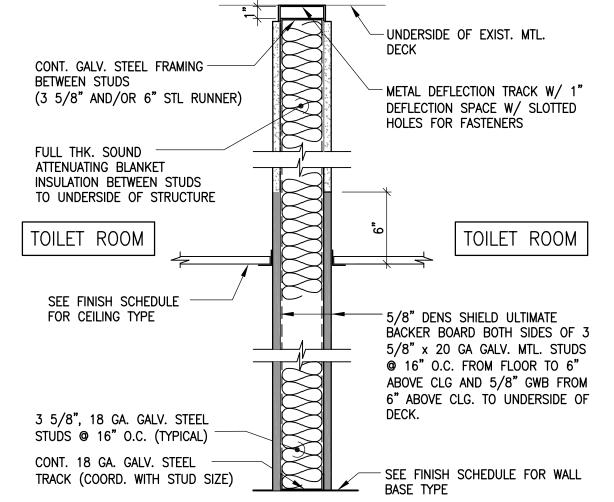


TYP. TOILET PARTITION

TYPE 'B1' SCALE: $1 \frac{1}{2} = 1'-0"$

- 3. ALL NEW PARTITIONS SHALL BE CONSTRUCTED WITH NON-COMBUSTIBLE MATERIALS AS SPECIFIED HEREIN AND/OR AS SHOW ON DRAWINGS.
- 4. FINISHED DOOR OPENINGS SHALL BE NOMINAL @ 6" FROM FINISHED CORNER OF ROOM AT HINGE SIDE, EXCEPT WHERE DIMENSIONED OTHERWISE
- 5. FOR ABBREVIATIONS AND ADDITIONAL SYMBOLS, REFER TO DRAWING C-000.00
- 6. ALL EXISTING WALL OPENINGS, NO LONGER NEEDED DUE TO MECHANICAL, ELECTRICAL OR OTHER TRADE REMOVALS SHALL BE SEALED AND PATCHED BY THE CONTRACTOR. NEW CONSTRUCTION AND FINISHES SHALL MATCH THOSE USED ON ADJACENT SURFACES. CLOSURE SHALL PROVIDE FIRE RESISTANCE CHARACTERISTICS OF THE SURROUNDING CONSTRUCTION.
- ALL CONCRETE SLAB SURFACES DAMAGED BY THE DEMOLITION SCOPE OF WORK AND OR EQUIPMENT REMOVALS SHALL BE REPAIRED AS REQUIRED TO PROVIDE A LEVEL AND FLUSH FINISHED SURFACE.
- REFER ALSO TO CODE COMPLIANCE PLAN FOR MORE INFORMATION ON REQUIRED FIRE SMOKE RATINGS.

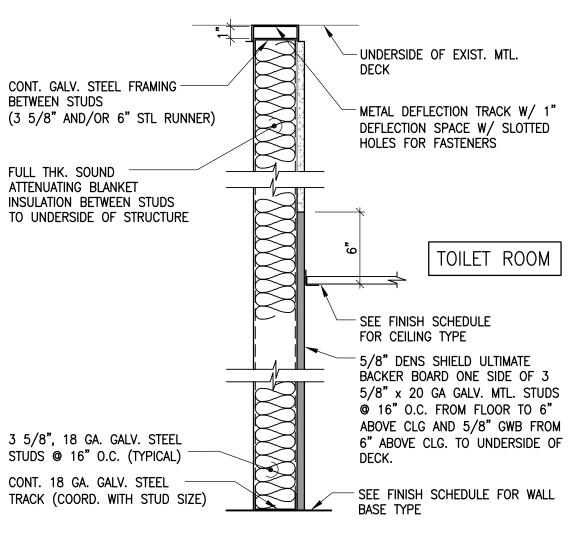

TYP. TOILET CHASE PARTITION TYPE 'B2' SCALE: $1 \frac{1}{2} = 1'-0"$

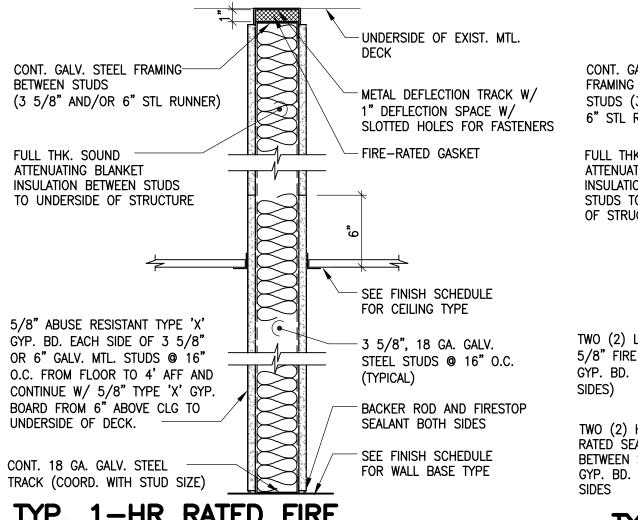

SCALE: $1 \frac{1}{2} = 1'-0"$

SCALE: $1 \frac{1}{2} = 1'-0"$

PROVIDE FIREPROOFING FOR ALL GAPS AND/OR OPENINGS THROUGH WALL CONSTRUCTION. FIREPROOF AS REQUIRED TO MAINTAIN FIRE RATING TO UNDERSIDE CONT. GALV. STEEL OF EXISTING METAL DECK FRAMING BETWEEN STUDS (3 5/8" AND/OR - METAL DEFLECTION TRACK 6" STL RUNNER) WITH 1" DEFLECTION SPACE WITH SLOTTED FULL THK. SOUND HOLES FOR FASTENERS ATTENUATING BLANKET INSULATION BETWEEN FIRE-RATED GASKET STUDS TO UNDERSIDE OF STRUCTURE - SEE FINISH SCHEDULE FOR CEILING TYPE TWO (2) LAYERS OF — 5/8" FIRE RATED GYP. BD. (TYP. BOTH 3 5/8", 18 GA. GALV. STEEL STUDS @ 16" O.C. TWO (2) HR. FIRE (TYPICAL) RATED SEALANT - SEE FINISH SCHEDULE BETWEEN SLAB AND FOR WALL BASE TYPE GYP. BD. - BOTH

UNDERSIDE OF EXIST. MTL.

HOLES FOR FASTENERS

SEE FINISH SCHEDULE

5/8" DENS SHIELD ULTIMATE

BACKER BOARD ONE SIDE OF 3

5/8" x 20 GA GALV. MTL. STUDS

@ 16" O.C. FROM FLOOR TO 6"

ABOVE CLG AND 5/8" GWB FROM

6" ABOVE CLG. TO UNDERSIDE OF

SEE FINISH SCHEDULE FOR WALL

FOR CEILING TYPE

BASE TYPE

-METAL DEFLECTION TRACK W/ 1'

DEFLECTION SPACE W/ SLOTTED

TOILET ROOM

DECK

TYP. TWO HOUR RATED FIRE PARTITION TYPE E U.L. DESIGN NO. U419

-EXIST. BLOCK WALL - CONT. GALV. STEEL (COORDINATE DEPTH - EXISTING CEILING 2 1/2" STEEL STUDS @ -CLG. MTD. CURTAI 16" O.C. (TYPICAL); TO BE ADJUSTED USE 3 5" STUDS AS REQ'D REQ'D TO ACCOMMODATE WALL RECESSED ELECTRICAL, MECHANICAL OR PLUMBING COMPONENTS LAYER OF 5/8" GYP. BD. FINISH, PAIN & WALL PROTECTION CONT. GALV. STEEL TRACK MATCH EXISTING. (COORDINATE SIZE W/ SIZE OF TRACK) -note: verify in field REQUIRE FURRING. TYP. TOILET FURRED

OUT PARTITION TYPE F

SCALE: $1 \frac{1}{2} = 1'-0"$

SECOND FLOOR PROPOSED RENOVATION

SECOND FLOOR CONSTRUCTION PLAN

Project No. Scale AS NOTED 225300004 Sheet Revision Drawing No.

12 of 22

TYP. 1-HR RATED FIRE PARTITION TYPE D (U.L. DESIGN NO. U465)

SCALE: $1 \frac{1}{2} = 1'-0"$

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden. Consultants

Hauppauge, NY 11749 Phone: (631) 738-1200 Fax: (631) 285-6464

www.BohlerEngineering.com

Stantec Consulting Services Inc.

100 Motor Parkway, Suite 420

Hauppauge, N.Y. 11788-4008

Copyright Reserved

Tel. 631.424.8600

www.stantec.com

ting Your Expect.

Mechanical & Electrical Engineering 200 Old Country Road, Suite 670 Mineola, NY 11501 Phone: (516) 484-1020

Fax: (516) 484-0926

www.leapc.com Key Plan AREA OF WORK 2,715 SQ FT

Revision GM BD 23.05.01 OMEGA ENVIRONMENTAL SERVICES GM BD 22.12.09 By Appd. YY.MM.DD File Name: 00004B_A-130 - Construction Plan.dwa Dwn. Chkd. Dsgn. YY.MM.DD

Permit-Seal

Client/Project

RICHMOND UNIVERSITY MEDICAL CENTER TRANSFORMATION GRANT

669 CASTLETON AVE, STATEN ISLAND, NY

ORIGINAL SHEET - ARCH D